



**Air-Conditioning, Heating, and Refrigeration
Institute (AHRI) Low-GWP Alternative Refrigerants
Evaluation Program (Low-GWP AREP)**

TEST REPORT #32

System Soft-Optimized Test of Refrigerant D2Y60 in Air Source Heat Pump

Abdullah Alabdulkarem
Dr. Yunho Hwang
Dr. Reinhard Radermacher

Center for Environmental Energy Engineering
Department of Mechanical Engineering
University of Maryland,
College Park, MD, 20742, USA

December 18, 2013

**This report has been made available to the public
as part of the author company's participation in the
AHRI's Low-GWP AREP.**



Air-Conditioning, Heating, and Refrigeration Institute
2111 Wilson Boulevard, Suite 500
Arlington VA 22201
(703) 524-8800
www.ahrinet.org

List of Tested Refrigerants' Compositions (Mass%)

| | |
|-------|-----------------------|
| D2Y60 | R-32/R-1234yf (40/60) |
|-------|-----------------------|

1. Background

The Air-Conditioning, Heating, and Refrigeration Institute (AHRI) announced an industry-wide cooperative research program to evaluate alternative refrigerants that have low global warming potential (GWP). The program aims at testing several refrigerants for major product categories such as air conditioners, heat pumps, chillers and refrigeration equipment. The program consists of three testing: compressor calorimeter testing, system drop-in testing and soft-optimized system testing.

2. Objective

The main objective of this report is to compare the baseline refrigerant, R410A, against the soft-optimized D2Y60 refrigerant as well as the drop-in test D2Y60 (AHRI Low-GWP AREP Test Report #20) as well as. The soft-optimized refrigerant has a large displacement compressor than the drop-in and the baseline refrigerants. The soft-optimized refrigerant has a TXV for heating instead of an orifice as the case for the drop-in and the baseline refrigerants.

3. Approach

The tests to be performed are drop-in test using the environmental chamber at the heat pump laboratory of the CEEE. The test unit itself is a residential split heat pump manufactured by Goodman. The nominal capacity of the unit is 3 tons. The testing followed ASHRAE standard 116-1995 shown in Table 1.

Table 1: ASHRAE Standard 116-1995 Test Matrix

| Test | Indoor | | Outdoor | | Operation |
|--------------------|--------|---------|---------|--------|--------------------------------|
| | DB | WB | DB | WB | |
| Extended condition | 26.7°C | 19.4°C | 46.1°C | NA | Steady State Cooling |
| A | | | 35.0°C | | Steady State Cooling |
| B | | | 27.8°C | | Steady State Cooling |
| C | | ≤13.9°C | 27.8°C | | Steady State Cooling, dry coil |
| D | | | | | Cyclic Cooling, dry coil |
| High Temp2 | 21.1°C | ≤15.6°C | 8.3°C | 6.1°C | Steady State Heating |
| High Temp1 | | | 16.7°C | 14.7°C | Steady State Heating |
| Low Temp | | | -8.3°C | -9.4°C | Steady State Heating |
| Extended condition | | | -17.8°C | NA | Steady State Heating |
| High Temp Cyclic | | | 8.3°C | 6.1°C | Cyclic Heating |
| Frost Acc. | | | 1.7°C | 0.6°C | Steady State Defrost |

4. R410A Baseline and D2Y60 Performance Evaluation

The heat pump unit that was tested is a 3 Tons Goodman heat pump. The specifications of the unit are shown in Table 2.

Table 2: Heat Pump Unit Specifications

| | |
|---------------------------|--------------------------------------|
| Manufacturer | Goodman |
| Outdoor Unit Model Number | SSZ140361BA |
| Indoor Unit Model Number | ARUF374316 |
| Compressor | Single Speed, Scroll Compressor |
| Nominal Cooling Capacity | 3 Tons |
| Rated SEER | 14 |
| Rated HSPF | 8.7 |
| Expansion Device | TXV for Cooling/ Orifice for Heating |

4.1 Instrumentation and Measurement

Figure 1 shows the test facility used in this study. To calculate the capacity and COP of the heat pump system, pressures, temperatures and mass flow rates were measured for both the refrigerant side and the air side of the system. A power meter and a line voltage transducer were installed to measure the power consumption and line voltage of the outdoor unit, respectively. In addition, relative humidity sensors were applied to measure the air relative humidity in the closed air loop, and dew point sensors were applied to measure the outdoor unit inlet and outlet air dew point.

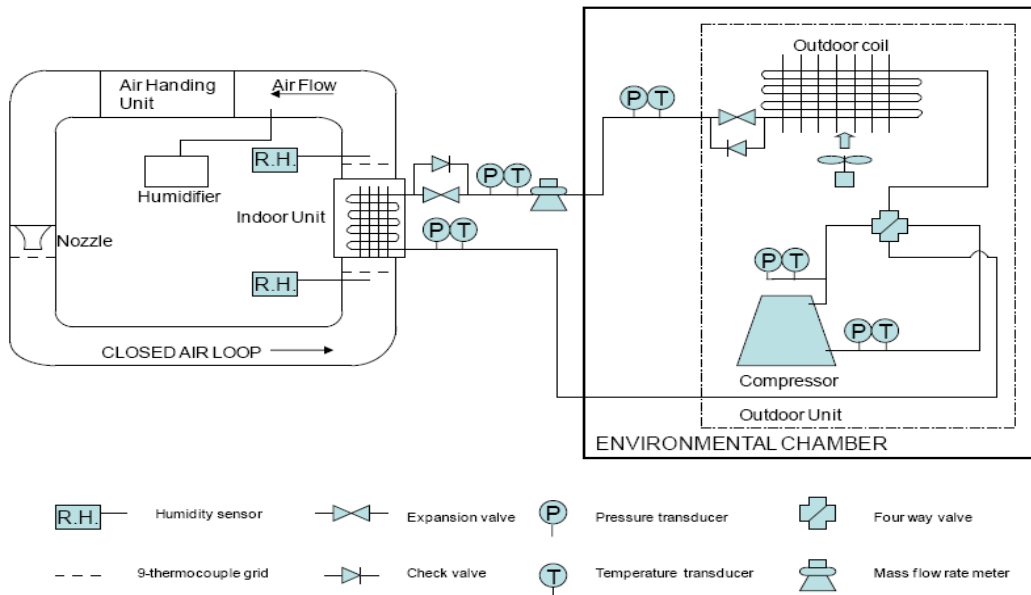


Figure 1: Schematic of Test Facility setup.

4.1.1 Temperature Measurement

The temperatures of the refrigerant at different locations were measured by T-type in-stream thermocouples. The locations of those thermocouples are illustrated in Figure 1. Thermocouples were inserted into the refrigerant tube line, and contacted the refrigerant flow directly to measure the temperature accurately. In the case of the airside temperature measurements, two thermocouple grids were installed at the upstream and the downstream of the indoor unit, which is shown in Figure 1. Each thermocouple grid consisted of nine T-type thermocouples. The thermocouples were distributed evenly in a particular cross-section area, and connected in parallel to measure the average temperature of the air flowing through the cross-section area (ASHRAE Handbook, 2001). Mesh sheets were installed in front of the thermocouple grids to ensure a uniform air flow profile. Two thermocouple grids were installed at the inlet and outlet of the outdoor unit, respectively, to measure the air temperature entering and leaving the outdoor unit. The specifications of the thermocouples are shown in Table 3.

Table 3: Specifications of Thermocouples

| | |
|-------------------|-------------------------|
| Manufacturer | Omega Engineering, Inc. |
| Model No. | T Type Thermocouple |
| Temperature range | -270°C to 400°C |
| Accuracy | 0.5°C |

4.1.2 Pressure Measurement

Pressure transducers were installed in the refrigerant tube lines to measure the pressures of the refrigerant. The locations of the pressure transducers are illustrated in Figure 1. A differential pressure transducer was installed to measure the pressure drop across the nozzle in the closed air loop. The specifications of the pressure transducers and the differential pressure transducer are listed in Table 4.

Table 4: Specifications of Pressure Transducers

| Item | Pressure Transducers | Pressure Transducers | Differential Pressure Transducers |
|--------------|----------------------|----------------------|-----------------------------------|
| Manufacturer | Setra Systems, Inc | WIKA, Inc | Setra System, Inc |
| Model No. | 280E | S-10 | 264 |
| Range | 0 ~ 3,447 kPa | 0 ~ 6,894 kPa | 0 ~ 1.245 kPa |
| Accuracy | ±0.11% Full Scale | ±0.125% Full Scale | ±1% Full Scale |

4.1.3 Relative Humidity Measurement

The relative humidity of the air in the closed loop was measured by two humidity sensors, located at the upstream and downstream of the indoor unit. The relative humidity together with the temperature of the air was used to calculate the air properties in the closed loop. The specifications of the humidity sensors are shown in Table 5.

Table 5: Specifications of Humidity Sensors

| | |
|----------------------|--------------------------|
| Manufacturer | Vaisala |
| Model No. | HMP233 |
| Range | -40°C to 80°C, 0 to 100% |
| RH accuracy | ±1% Measured |
| Temperature accuracy | ±0.2°C |
| Stability | ±0.5% Annual |

4.1.4 Dew Point Measurement

Two dew point sensors were used to measure the dew points of the outdoor unit inlet and outlet air. Specifications of the dew point sensors are shown in Table 6.

Table 6: Specifications of Dew Point Sensors

| | |
|--------------------|-----------------|
| Manufacturer | General Eastern |
| Model No. | Hygro-M2 |
| Range | -80°C to 95°C |
| Dew point accuracy | ±0.2 °C |

4.1.5 Power Consumption and Line Voltage Measurements

The power consumption and line voltage of the heat pump system were measured by an AC watt transducer and a voltage transducer, respectively. The specification of the watt transducer and line voltage transducer are shown in Table 7.

Table 7: Specifications of AC Watt Transducer

| | | |
|--------------|------------------|-------------------|
| Manufacturer | Ohio Semitronics | |
| Model No. | PC5 | VT-240A |
| Range | 0 to 5 kW | 0 to 300 V |
| Accuracy | ±0.5% Full Scale | ±0.25% Full Scale |

4.1.6 Mass Flow Rate and Volume Flow Rate Measurements

The refrigerant mass flow rates were measured by a Coriolis mass flow meter. The location of the mass flow rate meter is shown in Figure 1. The mass flow meter was installed in the liquid lines of the system to avoid the reading fluctuation caused by the two-phase flow. The specification of the mass flow meter is shown in Table 8.

Table 8: Specifications of Mass Flow Meter

| Item | Mass flow meter |
|----------------|---|
| Manufacturer | Micro Motion, Inc. |
| Model No. | DS 025 |
| Range | 0 ~ 100 g/s |
| Zero stability | 0.038g/s |
| Accuracy | $\pm 0.15\% \pm [(ZeroStability / Flowrate)100\%]$ % of flow rate |

The air volume flow rate in the closed loop was measured by a standard 6-inch nozzle. The nozzle was installed in the closed loop, which is shown in Figure 1. The air volume flow rate was calculated by Equation 1 (ASHRAE Standard, 41.2-1987).

$$V = \left[(C_d A_6) Y \left(\frac{2\Delta P}{\rho} \right)^{0.5} \right] / (1 - E\beta^4)^{0.5} \quad (1)$$

Where, C_d is the discharge coefficient, A_6 is the area measured at the plane of nozzle exit

$$Y = 1 - (0.548 + 0.71\beta^4)(1 - \alpha)$$

$$\alpha = 1 - \Delta P / (\rho R(t_o + 273.2))$$

$$\beta = D_6 / D_x$$

ΔP is the pressure drop across the nozzle

t_o is the inlet air temperature

ρ is the inlet air density

D_6 is the nozzle exit diameter

D_x is the duct diameter

$E = 1.043$ for duct approach

The discharge coefficient has been determined as 0.986 according to the nozzle calibration.

4.2 Calibration

The calibration of the instrumentation was conducted before the experimental study. Thermocouples were tested in ice/water bath. Pressure transducers were calibrated by using a

digital pressure calibrator having a resolution of 0.1 kPa. The refrigerant mass flow meter was calibrated by weighing water in a specific time period.

4.3 Data Acquisition

Instruments in the air side and the refrigerant side were connected to FieldPoint data acquisition modules supplied National Instruments (National Instruments). The modules were connected to a data acquisition computer, and communicated with a data acquisition program. The data acquisition program was developed by using the LabView software package (National Instruments). The program visualized the measured parameters (pressure, temperature, relative humidity, dew point, mass flow rate, and power consumption) in the form of numbers and graphs on the computer screen. The data was measured with a two-second interval. The data in steady state condition was recorded for 30 minutes, and averaged for the system performance analysis. The steady state operation was defined as follows: the variations of the airside temperatures are within $\pm 1\text{K}$ of the average values. The saturated refrigerant temperatures corresponding to the measured refrigerant-side pressures have maximum variations of $\pm 1.7\text{ K}$ of the average values. The refrigerant mass flow rate fluctuations were within 2% of the readings (ASHRAE Standard, 37-2005).

4.4 Performance Evaluation

4.4.1 Air Side Capacity

Air side capacity was calculated by multiplying the air mass flow rate and the inlet and outlet air enthalpy difference in the closed air loop, as described by the Equation 2:

$$Q_{\text{air}} = \dot{m}_{\text{air}} \Delta h_{\text{air}} \quad (2)$$

where \dot{m}_{air} is the air mass flow rate in the closed air loop, and Δh_{air} is the inlet and outlet air enthalpy difference of the indoor coil.

When there was condensation occurring in the indoor coil (ASHRAE Extended cooling condition, ASHRAE A cooling condition and ASHRAE B cooling condition), Equation 2 was used. When the relative humidity was low and there was no condensation occurring, Equation 3 was used:

$$Q_{\text{air}} = \dot{m}_{\text{air}} C_p \Delta t_{\text{air}} \quad (3)$$

where C_p is the specific heat of air and Δt_{air} is the inlet and outlet air temperature difference.

4.4.2 Refrigerant Side Capacity

Refrigerant side capacity was calculated by multiplying the refrigerant mass flow by the inlet and outlet enthalpy difference, which is shown in Equation 4:

$$Q_{\text{ref}} = \dot{m}_{\text{ref}} \Delta h_{\text{ref}} \quad (4)$$

where \dot{m}_{ref} is the refrigerant mass flow rate and Δh_{ref} is the refrigerant enthalpy difference of the inlet and outlet of the indoor coil.

4.4.3 Energy Balance

Energy balance was defined as the capacity difference between the refrigerant side and air side divided by refrigerant side capacity, described by Equation 5:

$$\text{Energy Balance} = (Q_{\text{ref}} - Q_{\text{air}}) / Q_{\text{ref}} \quad (5)$$

4.4.4 Power Consumption

Outdoor power consumption was directly measured by a watt meter, which included the compressor power and fan power. Power consumption of the control board was neglected because all controls were disconnected, except for the relay, which consumed negligible power. The original blower matching the indoor unit was disassembled and the indoor air was driven by a blower of the air handling unit in the closed air loop. Therefore, the realistic power consumption by the Original Equipment Manufacturer (OEM) blower could not be measured directly. To consider the effect of indoor blower on the system performance, power consumption data from the OEM was used. The average power consumption of the original blower matching the indoor coil was 373 W with air volume flow rate set at 1,200 CFM.

4.4.5 Coefficient of Performance

The Coefficient of Performance (COP) was defined as the net refrigerant side capacity divided by total power consumption, described by Equation 6:

$$\text{COP} = \dot{Q}_{\text{ref}} / P_{\text{total}} \quad (6)$$

where \dot{Q}_{ref} is the net refrigerant side capacity, including the indoor blower effect on the capacity. For the cooling mode, \dot{Q}_{ref} equals the refrigerant side capacity minus the indoor blower power consumption. For the heating mode, \dot{Q}_{ref} equals the refrigerant side capacity plus the indoor blower power consumption. P_{total} is the total power consumption, including the compressor, the outdoor fan and the indoor blower power consumption.

4.4.6 Compressor Efficiencies

The compressor isentropic efficiency and volumetric efficiency are described by Equation 7 and Equation 8, respectively:

$$\text{Isentropic efficiency, } \eta_{\text{Isen}} = (h_{\text{out,s}} - h_{\text{in}}) / (h_{\text{out}} - h_{\text{in}}) \quad (7)$$

$$\text{Volumetric efficiency, } \eta_{\text{Vol}} = \dot{m}_{\text{Ref}} / (\rho V \text{ RPM}) \quad (8)$$

4.5 D2Y60 Refrigerant Soft Optimized System Test Results

D2Y60 capacity was lower than R410A by on average of 18% for cooling and 14% for heating. D2Y60 saturated vapor density at 10°C was about 28% less than R410A. One way to increase the capacity is to replace the compressor with a larger one. The drop in test had a compressor size of 27.53 cm³. The compressor was replaced with a single speed, scroll compressor that has a volume of 36 cm³.

Another difference between drop in and soft-optimized system is that the soft-optimized has a TXV instead of orifice for heating. The original heat pump unit came with a TXV for cooling and an orifice for heating. The orifice was replaced by a TXV during L41A soft-optimized tests and kept for D2Y60 soft-optimized tests. The TXV was adjusted to maintain a superheating around 2 K for High Temperature test 2, and this adjustment was kept the same throughout the tests.

4.5.1 Charge Optimization

This section re-presents the results from the drop-in tests. During the drop in test, charge optimization was conducted for cooling mode. The charge for the soft-optimized test was not changed from the drop-in test (i.e., charge optimization was not conducted for soft optimized system). ASHRAE A cooling condition was used for charge optimization. R410A refrigerant charge was varied from 4.6 kg to 5.5 kg. Capacity and COP (for cooling) variations with the increase of refrigerant charge are shown in Figure 2. Superheat and subcooling (for cooling) variations with the increase of refrigerant charge are shown in Figure 3. Maximum COP occurred at 5.19 kg (11.44 lb) charge where subcooling was 2.9 K.

D2Y60 refrigerant charge was varied from 4.30 kg to 5.84 kg. Capacity and COP variations with the increase of refrigerant charge are shown in Figure 4. The TXV opening was too large for D2Y60 because no superheating was observed. Therefore, the TXV was adjusted by rotating the stem 6.5 turns clockwise. Superheat and subcooling variations with the increase of refrigerant charge are shown in Figure 5. Maximum COP occurred at 5.12 kg (11.29 lb) charge.

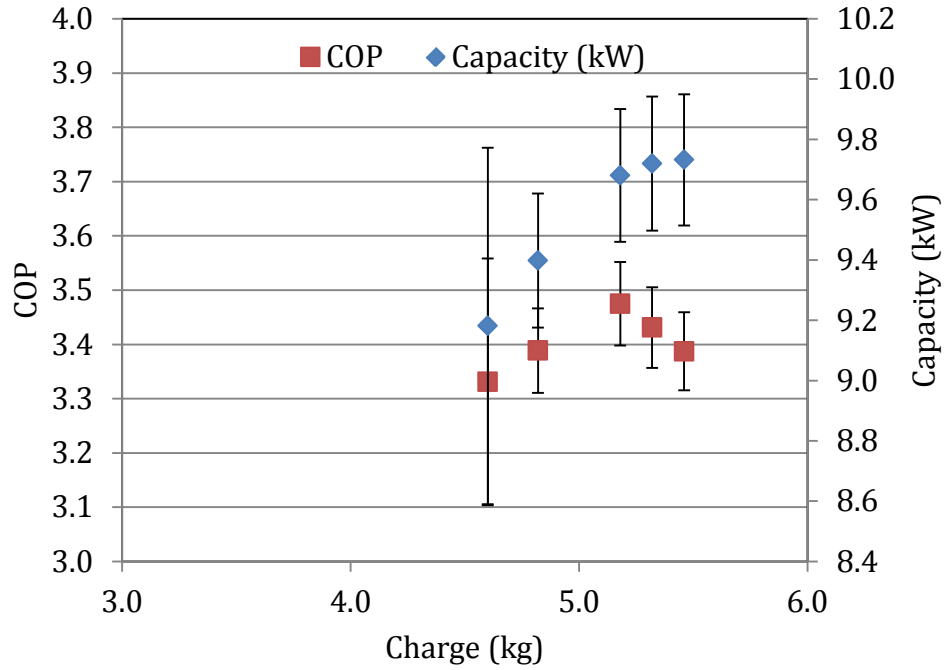


Figure 2: COP and Capacity vs. R410A Refrigerant Charge
 $Q(\text{kBtu/hr})=3.412*Q(\text{kW})$, $\text{EER}=3.412*\text{COP}$, $m(\text{lb})=0.45*m(\text{kg})$

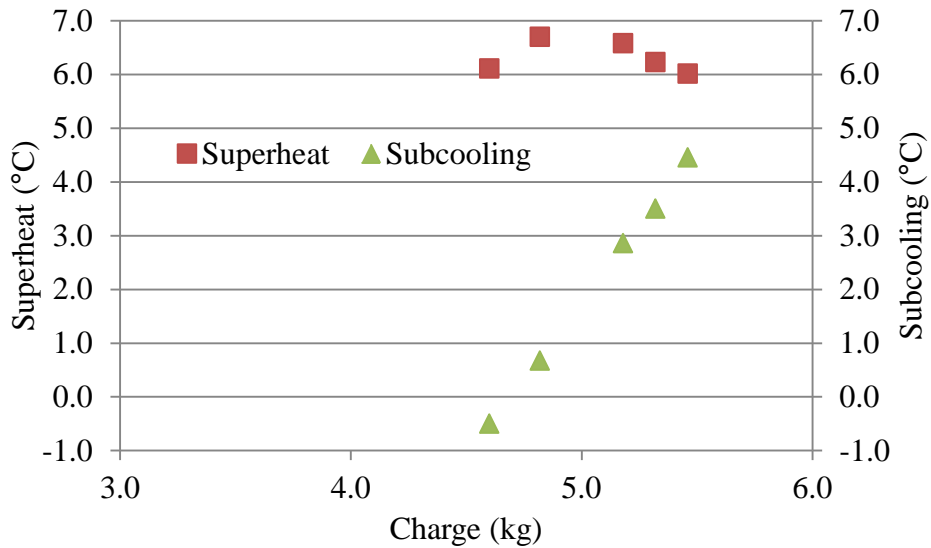


Figure 3: Superheat and Subcooling vs. R410A Refrigerant Charge
 $\Delta T(\text{F})=1.8*\Delta T(\text{°C})$, $m(\text{lb})=0.45*m(\text{kg})$

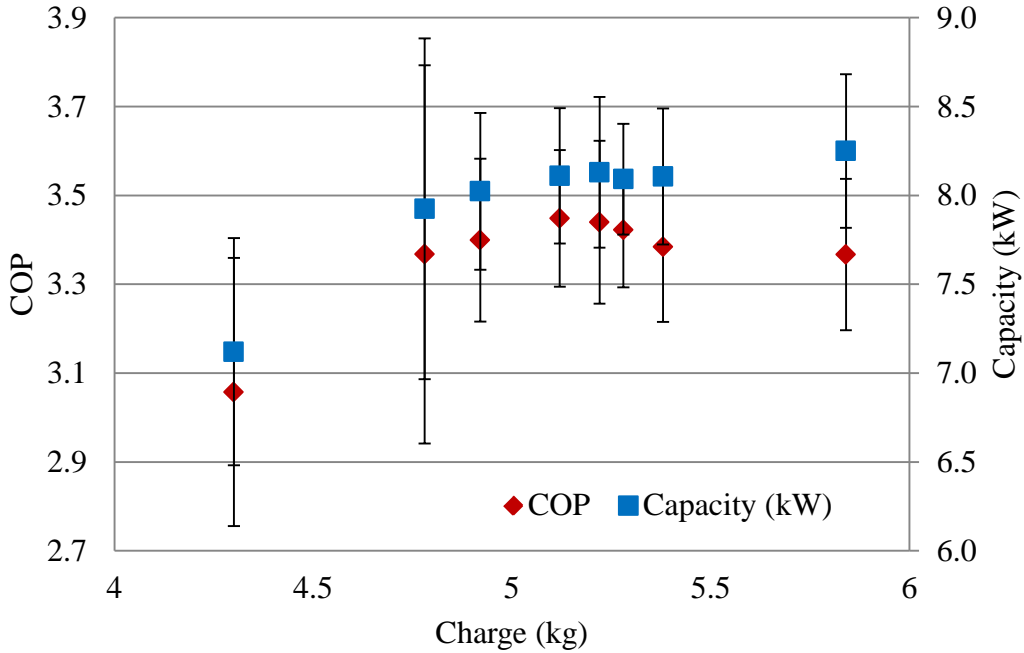


Figure 4: COP and Capacity vs. D2Y60 Refrigerant Charge
 $Q(\text{kBtu/hr})=3.412*Q(\text{kW})$, $\text{EER}=3.412*\text{COP}$, $\text{m}(\text{lb})=0.45*\text{m}(\text{kg})$

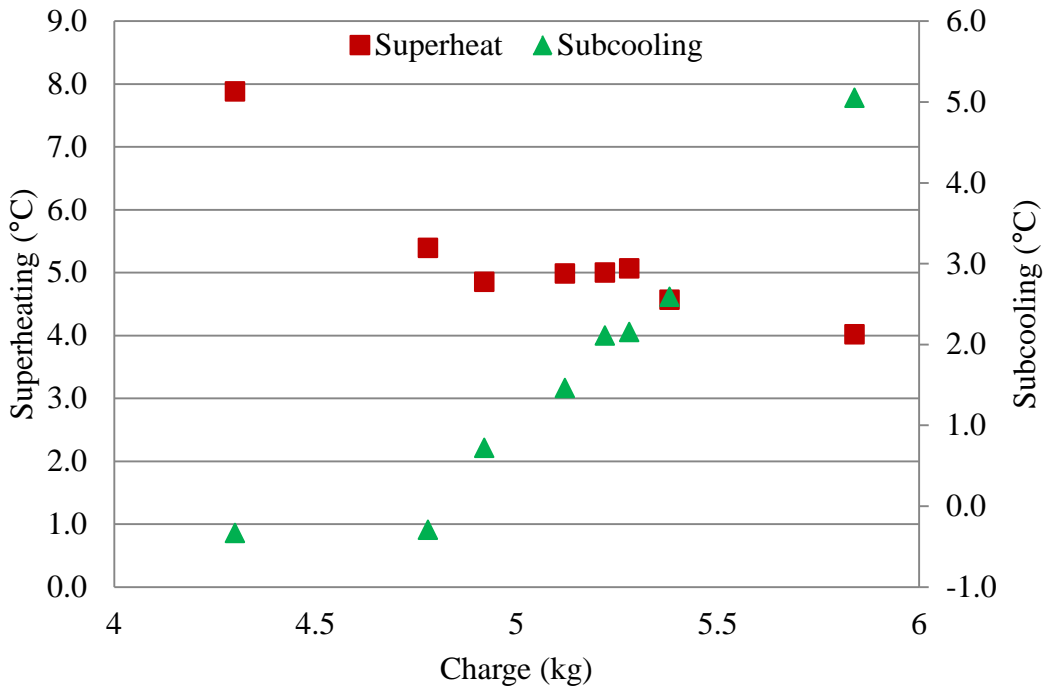


Figure 5: Superheat and Subcooling vs. D2Y60 Refrigerant Charge.
 $\Delta T(\text{F})=1.8*\Delta T(\text{°C})$, $\text{m}(\text{lb})=0.45*\text{m}(\text{kg})$

4.6.1 Steady State Cooling Test Results Comparison

The comparisons of the steady state heating test results are shown in Figure 6 and Figure 7. The results of D2Y60 soft optimized show that the capacity is about 5.6% less than R410A and about 15% more than D2Y60 drop in. Furthermore, D2Y60 soft optimized COP is about 10.5% less than R410A and about 6.5% less than D2Y60 drop in. The capacity increase as well as the compressor power increase because of the increase in the refrigerant mass flow rate with the larger compressor. The detailed soft optimized test conditions and results are provided in Section 5. The detailed drop in test can be found in (AHRI Low-GWP AREP Test Report #20).

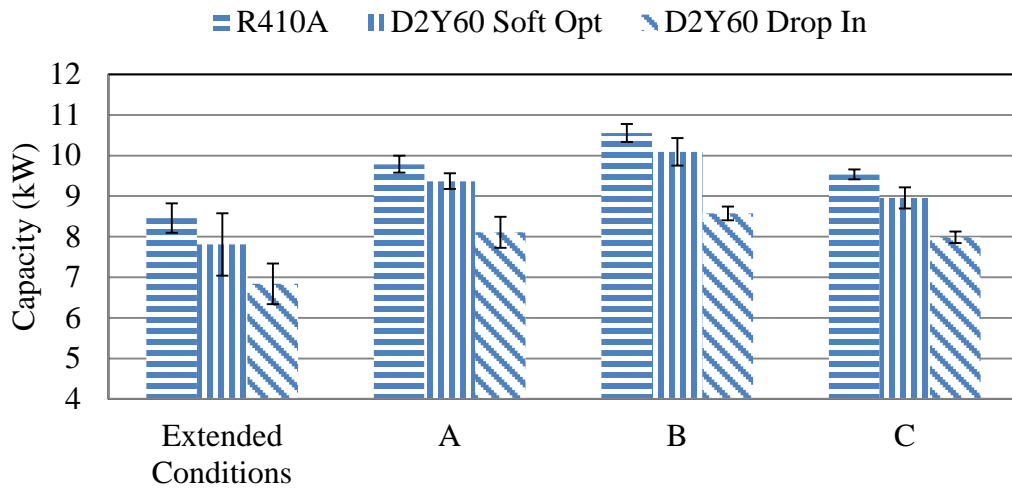


Figure 6: D2Y60 vs. R410A Cooling Test Results: Capacity.
 $Q(\text{kBtu/hr})=3.412*Q(\text{kW})$

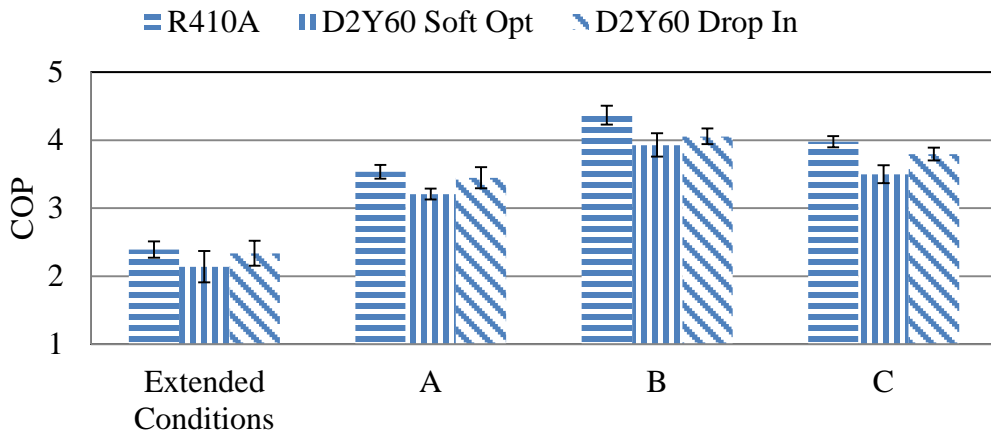


Figure 7: D2Y60 vs. R410A Cooling Test Results: COP.
 $EER=3.412*COP$

4.6.1 Steady State Heating Test Results Comparison

The comparisons of the steady state heating test results are shown in Figure 8 and Figure 9. The results of D2Y60 soft optimized show that the capacity is about 4.4% more than R410A and 27% more than D2Y60 drop in. Furthermore, D2Y60 soft optimized COP is about similar to R410A and about 3% less than D2Y60 drop in. The detailed soft optimized test conditions and results are provided in Section 6. The detailed drop in test can be found in (AHRI Low-GWP AREP Test Report #20).

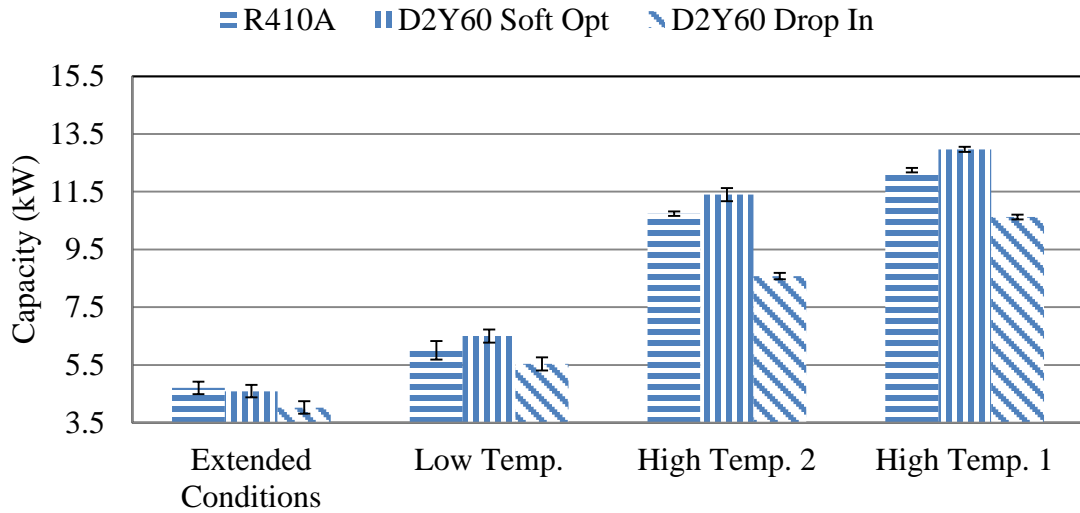


Figure 8: D2Y60 vs. R410A Heating Test Results: Capacity.
 $Q(\text{kBtu/hr})=3.412*Q(\text{kW})$

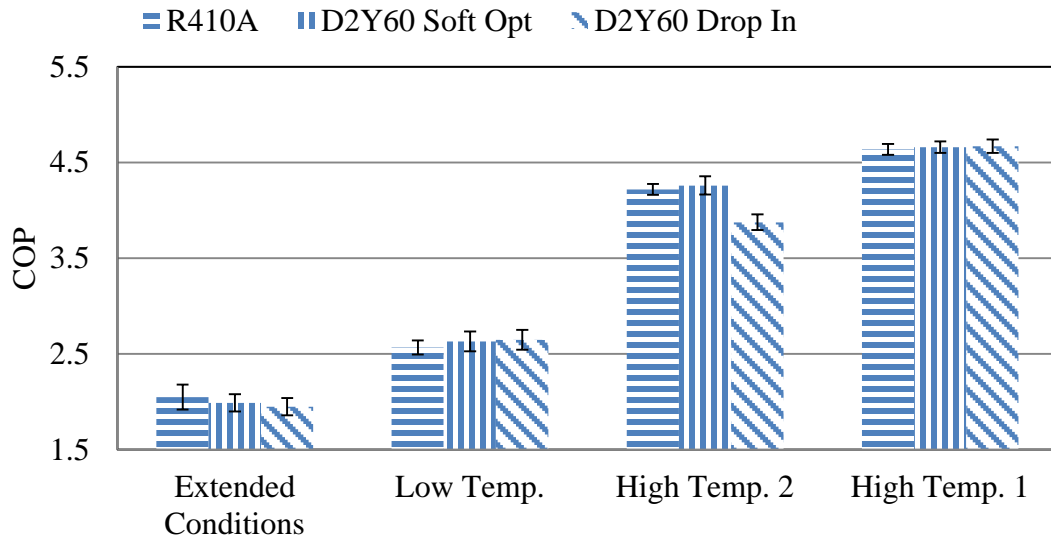


Figure 9: D2Y60 vs. R410A Heating Test Results: COP.
 $EER=3.412*COP$

5 Detailed Cooling Test Results for R410A vs D2Y60

Testing Participant: UMD-CEEE

Participant's Notation: Ext. test

| Basic Information | |
|--|-------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr, Heat Pump |

| Comparison Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio | |
|--|-----------------|--------------|---------------------|-------|--------|----------------------|-------|--|
| Mode (Heating/Cooling) | Cooling | | | | | | | |
| Compressor Type | Scroll | Scroll | | | | | | |
| Compressor Displacement | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 | |
| Nominal Motor Size | 3.8 | 3.8 | hp | | | | 1 | |
| Motor Speed | 3500 | 3500 | rpm | | | | 1 | |
| Expansion Device Type | R410A TXV | R410A TXV | | | | | | |
| Lubricant Charge | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 | |
| Refrigerant Charge | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 | |
| Refrigerant Mass Flow Rate | 3.71 | 3.64 | kg/min | 8.18 | 8.18 | lb/min | 0.98 | |
| Composition, at compr. Inlet if applicable | | | %wt | | | | | |
| Ambient Temps. | Indoor, db | 26.4 | 26.51 | °C | 79.52 | 79.71 | F | |
| | Indoor, rh | 50.7 | 50.56 | % | 50.70 | 50.56 | % | |
| | Outdoor db | 46.78 | 46.33 | °C | 116.20 | 115.39 | F | |
| | Outdoor, dew pt | 37.17 | 28.66 | °C | 98.87 | 83.58 | F | |
| Total Capacity | 8.47 | 7.81 | kW | 28.90 | 26.64 | kBtu/hr | 0.92 | |
| Sensible Capacity | 7.03 | 6.90 | kW | 23.99 | 23.54 | kBtu/hr | 0.98 | |
| Total System Power Input | 3.53 | 3.64 | kW | 3.53 | 3.64 | kW | 1.03 | |
| Compressor Power Input | 3.16 | 3.27 | kW | 3.16 | 3.27 | kW | 1.04 | |
| Energy Efficiency Ratio (EER) | 8.17 | 7.31 | W/W | 27.88 | 24.94 | Btu/W | 0.89 | |
| Coeff. of Performance (COP) | 2.4 | 2.14 | | | | | 0.89 | |

| Other System Changes |
|--|
| 6.5 Clockwise TXV adjustment compared to R410A |
| |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|---------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 34.17 | 33.99 | m ³ /min | 1206.62 | 1200.32 | ft ³ /min | 0.99 |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 26.4 | 26.51 | °C | 79.52 | 79.71 | F | |
| Outlet Temperature | 15.86 | 16.11 | °C | 60.55 | 60.99 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 46.78 | 46.33 | °C | 116.20 | 115.39 | F | |
| Outlet Temperature | 52.84 | 52.69 | °C | 127.11 | 126.84 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|---|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | 24.2 | 1134.08 | 22.47 | 867.21 | 75.56 | 164.48 | 72.44 | 125.78 |
| Compressor Discharge | 94.71 | 3372.5 | 93.16 | 2842.49 | 202.48 | 489.14 | 199.69 | 412.27 |
| Condenser Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Condenser Outlet | 51.21 | 3331.57 | 50.89 | 2782.74 | 124.18 | 483.20 | 123.60 | 403.60 |
| Expansion Device Inlet | 49.59 | 3281.7 | 49.68 | 2745.01 | 121.26 | 475.97 | 121.43 | 398.13 |
| Subcooling, at expan. device | 2.38 | N/A | 3.32 | N/A | 4.28 | N/A | 5.98 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | 14.96 | 1179.69 | 14.90 | 906.96 | 58.93 | 171.10 | 58.83 | 131.54 |
| Evaporator Superheat | 2.09 | N/A | -0.24 | N/A | 3.76 | N/A | -0.43 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

Testing Participant: UMD-CEEE

Participant's Notation: A test

| Basic Information | |
|--|--------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr , Heat Pump |

| Comparison Data | | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|--|-----------------|-----------|-----------|---------------------|-------|-------|----------------------|-------|
| Mode (Heating/Cooling) | | Cooling | | | | | | |
| Compressor Type | | Scroll | Scroll | | | | | |
| Compressor Displacement | | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 |
| Nominal Motor Size | | 3.8 | 3.8 | hp | | | | 1 |
| Motor Speed | | 3500 | 3500 | rpm | | | | 1 |
| Expansion Device Type | | R410A TXV | R410A TXV | | | | | |
| Lubricant Charge | | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 |
| Refrigerant Charge | | 5.19 | 5.12 | kg | 11.44 | 10.45 | lb | 0.91 |
| Refrigerant Mass Flow Rate | | 3.74 | 3.65 | kg/min | 8.25 | 8.04 | lb/min | 0.98 |
| Composition, at compr. Inlet if applicable | | | | % wt | | | | |
| Ambient Temps. | Indoor, db | 26.42 | 26.50 | °C | 79.56 | 79.71 | F | |
| | Indoor, rh | 50.97 | 50.60 | % | 50.97 | 50.60 | % | |
| | Outdoor db | 34.68 | 34.68 | °C | 94.42 | 94.42 | F | |
| | Outdoor, dew pt | 20.57 | 20.77 | °C | 69.03 | 69.38 | F | |
| Total Capacity | | 9.78 | 9.37 | kW | 33.37 | 31.98 | kBtu/hr | 0.96 |
| Sensible Capacity | | 7.45 | 7.55 | kW | 25.42 | 25.75 | kBtu/hr | 1.01 |
| Total System Power Input | | 2.77 | 2.92 | kW | 2.77 | 2.92 | kW | 1.05 |
| Compressor Power Input | | 2.4 | 2.54 | kW | 2.40 | 2.54 | kW | 1.06 |
| Energy Efficiency Ratio (EER) | | 12.05 | 10.96 | Btu-hr/W | | | | 0.91 |
| Coeff. of Performance (COP) | | 3.53 | 3.21 | | | | | 0.91 |

| Other System Changes |
|--|
| 6.5 Clockwise TXV adjustment compared to R410A |
| |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|---------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 34 | 33.98 | m ³ /min | 1200.58 | 1199.87 | ft ³ /min | 1.00 |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 26.42 | 26.50 | °C | 79.56 | 79.71 | F | |
| Outlet Temperature | 15.2 | 15.13 | °C | 59.36 | 59.23 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 34.68 | 34.68 | °C | 94.42 | 94.42 | F | |
| Outlet Temperature | 40.82 | 40.85 | °C | 105.48 | 105.53 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|--|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | 19.83 | 1099 | 20.52 | 846.43 | 67.69 | 159.40 | 68.94 | 122.76 |
| Compressor Discharge | 73.19 | 2608.8 | 75.24 | 2213.11 | 163.74 | 378.37 | 167.43 | 320.98 |
| Condenser Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Condenser Outlet | 39.55 | 2566.52 | 39.58 | 2154.03 | 103.19 | 372.24 | 103.25 | 312.41 |
| Expansion Device Inlet | 38.77 | 2510.58 | 38.73 | 2109.83 | 101.79 | 364.13 | 101.71 | 306.00 |
| Subcooling, at expan. device | 2.79 | N/A | 3.16 | N/A | 5.02 | N/A | 5.69 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | 13.81 | 1142.64 | 14.91 | 884.39 | 56.86 | 165.73 | 58.84 | 128.27 |
| Evaporator Superheat | 2.05 | N/A | 0.61 | N/A | 3.69 | N/A | 1.10 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|------------------|
| Additional Notes |
| |
| |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

Testing Participant: UMD-CEEE

Participant's Notation: B test

| Basic Information | |
|--|--------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr , Heat Pump |

| Comparison Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio | |
|--|-----------------|--------------|---------------------|-------|-------|----------------------|-------|--|
| Mode (Heating/Cooling) | Cooling | | | | | | | |
| Compressor Type | Scroll | Scroll | | | | | | |
| Compressor Displacement | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 | |
| Nominal Motor Size | 3.8 | 3.8 | hp | | | | 1 | |
| Motor Speed | 3500 | 3500 | rpm | | | | 1 | |
| Expansion Device Type | R410A TXV | R410A TXV | | | | | | |
| Lubricant Charge | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 | |
| Refrigerant Charge | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 | |
| Refrigerant Mass Flow Rate | 3.74 | 3.65 | kg/min | 8.25 | 8.05 | lb/min | 0.98 | |
| Composition, at compr. Inlet if applicable | | | % wt | | | | | |
| Ambient Temps. | Indoor, db | 26.37 | 26.51 | °C | 79.47 | 79.73 | F | |
| | Indoor, rh | 51.07 | 50.48 | % | 51.07 | 50.48 | % | |
| | Outdoor db | 27.13 | 27.36 | °C | 80.83 | 81.25 | F | |
| | Outdoor, dew pt | 16.72 | 16.08 | °C | 62.10 | 60.95 | F | |
| Total Capacity | 10.56 | 10.09 | kW | 36.03 | 34.43 | kBtu/hr | 0.96 | |
| Sensible Capacity | 8.13 | 7.75 | kW | 27.74 | 26.45 | kBtu/hr | 0.95 | |
| Total System Power Input | 2.42 | 2.57 | kW | 2.42 | 2.57 | kW | 1.06 | |
| Compressor Power Input | 2.04 | 2.20 | kW | 2.04 | 2.20 | kW | 1.08 | |
| Energy Efficiency Ratio (EER) | 14.91 | 13.39 | Btu-hr/W | | | | 0.90 | |
| Coeff. of Performance (COP) | 4.37 | 3.93 | | | | | 0.90 | |

| |
|--|
| Other System Changes |
| 6.5 Clockwise TXV adjustment compared to R410A |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|---------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 35.09 | 33.98 | m ³ /min | 1239.19 | 1200.06 | ft ³ /min | 0.97 |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 26.37 | 26.51 | °C | 79.47 | 79.73 | F | |
| Outlet Temperature | 14.5 | 14.83 | °C | 58.10 | 58.69 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 27.13 | 27.36 | °C | 80.83 | 81.25 | F | |
| Outlet Temperature | 33.35 | 34.01 | °C | 92.03 | 93.21 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|--|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | 17.57 | 1082.69 | 18.82 | 836.37 | 63.63 | 157.03 | 65.88 | 121.30 |
| Compressor Discharge | 61.43 | 2201.06 | 64.91 | 1884.61 | 142.57 | 319.24 | 148.83 | 273.34 |
| Condenser Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Condenser Outlet | 32.17 | 2159.97 | 32.54 | 1823.26 | 89.91 | 313.28 | 90.57 | 264.44 |
| Expansion Device Inlet | 31.81 | 2100.12 | 31.92 | 1775.52 | 89.26 | 304.60 | 89.46 | 257.52 |
| Subcooling, at expan. device | 3.06 | N/A | 3.14 | N/A | 37.51 | N/A | 5.66 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | 13.27 | 1125.19 | 14.88 | 871.63 | 55.89 | 163.19 | 58.79 | 126.42 |
| Evaporator Superheat | 2.04 | N/A | 1.08 | N/A | 35.67 | N/A | 1.95 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|------------------|
| Additional Notes |
| |
| |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

Testing Participant: UMD-CEEE

Participant's Notation: C test

| Basic Information | |
|--|--------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr , Heat Pump |

| Comparison Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio | |
|---|-----------------|--------------|---------------------|-------|-------|----------------------|-------|--|
| Mode (Heating/Cooling) | Cooling | | | | | | | |
| Compressor Type | Scroll | Scroll | | | | | | |
| Compressor Displacement | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 | |
| Nominal Motor Size | 3.8 | 3.8 | hp | | | | 1 | |
| Motor Speed | 3500 | 3500 | rpm | | | | 1 | |
| Expansion Device Type | R410A TXV | R410A TXV | | | | | | |
| Lubricant Charge | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 | |
| Refrigerant Charge | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 | |
| Refrigerant Mass Flow Rate | 3.42 | 3.27 | kg/min | 7.54 | 7.22 | lb/min | 0.96 | |
| Composition, at compr. Inlet if applicable | | | % wt | | | | | |
| Ambient Temps. | Indoor, db | 26.36 | 26.42 | °C | 79.45 | 79.55 | F | |
| | Indoor, rh | 10.34 | 11.58 | % | 10.34 | 11.58 | % | |
| | Outdoor db | 26.94 | 27.39 | °C | 80.49 | 81.30 | F | |
| | Outdoor, dew pt | 16.33 | 16.50 | °C | 61.39 | 61.70 | F | |
| Total Capacity | 9.54 | 8.96 | kW | 32.55 | 30.58 | kBtu/hr | 0.94 | |
| Sensible Capacity | 9.57 | 9.81 | kW | 32.65 | 33.46 | kBtu/hr | 1.02 | |
| Total System Power Input | 2.4 | 2.56 | kW | 2.40 | 2.56 | kW | 1.07 | |
| Compressor Power Input | 2.02 | 2.18 | kW | 2.02 | 2.18 | kW | 1.08 | |
| Energy Efficiency Ratio (EER) | 13.58 | 11.96 | Btu-hr/W | | | | 0.88 | |
| Coeff. of Performance (COP) | 3.98 | 3.50 | | | | | 0.88 | |

| |
|--|
| Other System Changes |
| 6.5 Clockwise TXV adjustment compared to R410A |
| |
| |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|---------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 33.72 | 33.98 | m ³ /min | 1190.81 | 1199.93 | ft ³ /min | 1.01 |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 26.36 | 26.42 | °C | 79.45 | 79.55 | F | |
| Outlet Temperature | 11.92 | 11.73 | °C | 53.46 | 53.12 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 26.94 | 27.39 | °C | 80.49 | 81.30 | F | |
| Outlet Temperature | 32.61 | 33.42 | °C | 90.70 | 92.16 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|--|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | 14.55 | 996.4 | 17.48 | 761.42 | 58.19 | 144.51 | 63.46 | 110.43 |
| Compressor Discharge | 61.86 | 2157.12 | 67.55 | 1852.70 | 143.35 | 312.86 | 153.58 | 268.71 |
| Condenser Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Condenser Outlet | 31.6 | 2120.03 | 32.11 | 1802.70 | 88.88 | 307.48 | 89.79 | 261.46 |
| Expansion Device Inlet | 31.29 | 2067.43 | 31.63 | 1761.64 | 88.32 | 299.85 | 88.94 | 255.50 |
| Subcooling, at expan. device | 2.93 | N/A | 3.11 | N/A | 5.27 | N/A | 5.60 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | 9.07 | 1034.8 | 11.66 | 793.52 | 48.33 | 150.08 | 52.98 | 115.09 |
| Evaporator Superheat | 0.65 | N/A | 0.98 | N/A | 1.17 | N/A | 1.77 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|------------------|
| Additional Notes |
| |
| |
| |

- **Cyclic cooling tests (D test)**

The cyclic condition included two cycles. Each cycle was comprised of 6 minutes “on” time and 24 minutes “off” time (Figure 10). Specific calculation procedure followed ARI standard 210/240 (1995). The summary of the results of the cyclic cooling test (ASHRAE D) are shown in Table 8.

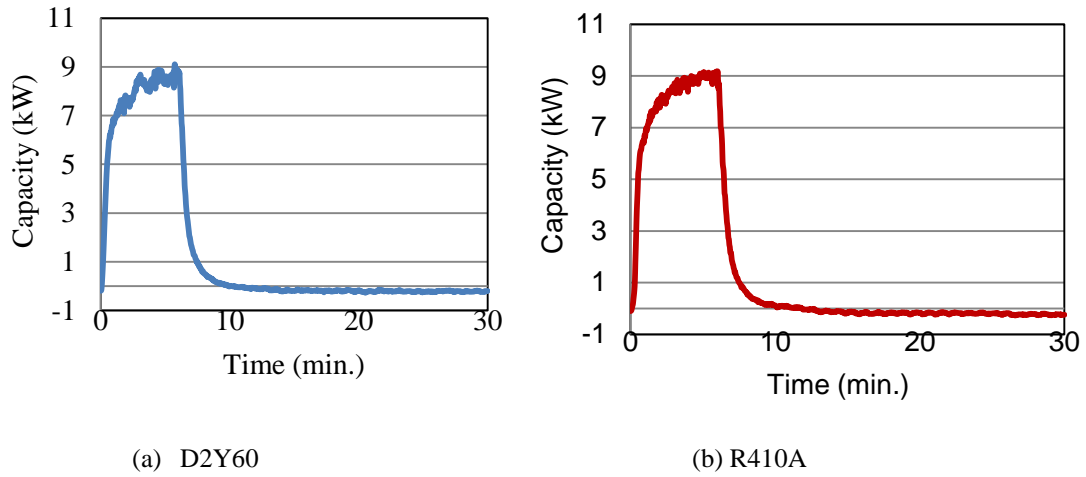


Figure 10: Cooling capacity vs. time for cyclic heating test.

Table 8: Cyclic cooling results and SEER.

| | Cooling-Air Side (kW-hr) | Power Consumption (kW-hr) | COP | Cooling Load Factor (CLF) | Degradation Coefficient (CD) | SEER |
|----------------|--------------------------|---------------------------|-------|---------------------------|------------------------------|-------|
| R410A | 0.826 | 0.249 | 3.321 | 0.18 | 0.16 | 13.71 |
| D2Y60 | 0.840 | 0.263 | 3.189 | 0.18 | 0.16 | 12.34 |
| Difference (%) | 2 | 6 | -4 | 0 | 0 | -10 |

6 Detailed Heating Test Results for R410A vs. D2Y60

Testing Participant: UMD-CEEE

Participant's Notation: Ext. Cond. Test

| Basic Information | |
|--|--------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr , Heat Pump |

| Comparison Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio | |
|--|-----------------|-----------|---------------------|-------|-------|----------------------|-------|--|
| Mode (Heating/Cooling) | Heating | | | | | | | |
| Compressor Type | Scroll | Scroll | | | | | | |
| Compressor Displacement | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 | |
| Nominal Motor Size | 3.8 | 3.8 | hp | | | | 1 | |
| Motor Speed | 3500 | 3500 | rpm | | | | 1 | |
| Expansion Device Type | R410A orifice | R410A TXV | | | | | | |
| Lubricant Charge | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 | |
| Refrigerant Charge | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 | |
| Refrigerant Mass Flow Rate | N/A | N/A | kg/min | N/A | N/A | lb/min | | |
| Composition, at compr. Inlet if applicable | | | % wt | | | | | |
| Ambient Temps. | Indoor, db | 21.5 | 21.16 | °C | 70.70 | 70.08 | F | |
| | Indoor, rh | 51.3 | 46.64 | % | 51.30 | 46.64 | % | |
| | Outdoor db | -17.82 | -17.16 | °C | -0.08 | 1.10 | F | |
| | Outdoor, dew pt | -18.85 | -19.87 | °C | -1.93 | -3.77 | F | |
| Total Capacity | 4.71 | 4.59 | kW | 16.07 | 15.67 | kBtu/hr | 0.97 | |
| Sensible Capacity | N/A | N/A | kW | N/A | N/A | kBtu/hr | | |
| Total System Power Input | 2.3 | 2.31 | kW | 2.30 | 2.31 | kW | 1.00 | |
| Compressor Power Input | 1.93 | 1.94 | kW | 1.93 | 1.94 | kW | 1.00 | |
| Energy Efficiency Ratio (EER) | 6.99 | 6.79 | Btu-hr/W | | | | 0.97 | |
| Coeff. of Performance (COP) | 2.05 | 1.99 | | | | | 0.97 | |

| Other System Changes |
|------------------------------|
| 3.5 TXV turns before closing |
| |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|----------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 21.5 | 21.16 | °C | 70.70 | 70.08 | F | |
| Outlet Temperature | 27.71 | 27.39 | °C | 81.88 | 81.30 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 35.11 | 33.98 | m ³ /min | 1239.78 | 1200.061 | ft ³ /min | 0.97 |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 21.5 | 21.16 | °C | 70.70 | 70.08 | F | |
| Outlet Temperature | 27.71 | 27.39 | °C | 81.88 | 81.30 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|---|----------|---------|-------------|----------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | -20.65 | 404.71 | -14.39 | 234.09 | -5.17 | 58.70 | 6.10 | 33.95 |
| Compressor Discharge | 53.74 | 1848.76 | 100.89 | 1513.85 | 128.73 | 268.14 | 213.60 | 219.56 |
| Condenser Inlet | 38.668 | 1825.25 | 58.9621 | 1512.327 | 101.60 | 264.73 | 138.13 | 219.34 |
| Condenser Outlet | 28.35 | 1809.52 | 21.35 | 1500.62 | 83.03 | 262.45 | 70.44 | 217.65 |
| Expansion Device Inlet | 26.89 | 1828.2 | 18.67 | 1535.46 | 80.40 | 265.16 | 65.61 | 222.70 |
| Subcooling, at expan. device | 1.84 | N/A | 10.06 | N/A | 3.31 | N/A | 18.11 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Suction Superheat | -1 | N/A | 9.81 | N/A | -1.8 | N/A | 17.66 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|---------------------------|
| Additional Notes |
| Air Side Capacity and COP |
| |
| |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

Testing Participant: UMD-CEEE

Participant's Notation: High Temp. 1 Test

| Basic Information | |
|--|--------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr , Heat Pump |

| Comparison Data | | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|--|-----------------|---------------|-----------|---------------------|-------|-------|----------------------|-------|
| Mode (Heating/Cooling) | | Heating | | | | | | |
| Compressor Type | | Scroll | Scroll | | | | | |
| Compressor Displacement | | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 |
| Nominal Motor Size | | 3.8 | 3.8 | hp | | | | 1 |
| Motor Speed | | 3500 | 3500 | rpm | | | | 1 |
| Expansion Device Type | | R410A orifice | R410A TXV | | | | | |
| Lubricant Charge | | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 |
| Refrigerant Charge | | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 |
| Refrigerant Mass Flow Rate | | 3.3 | 3.87 | kg/min | 7.28 | 8.53 | lb/min | 1.17 |
| Composition, at compr. Inlet if applicable | | | | % wt | | | | |
| Ambient Temps. | Indoor, db | 21.23 | 21.19 | °C | 70.21 | 70.14 | F | |
| | Indoor, rh | 58.8 | 57.79 | % | 58.80 | 57.79 | % | |
| | Outdoor db | 16.84 | 16.64 | °C | 62.31 | 61.95 | F | |
| | Outdoor, dew pt | 13.33 | 13.25 | °C | 55.99 | 55.85 | F | |
| Total Capacity | | 12.25 | 12.97 | kW | 41.80 | 44.26 | kBtu/hr | 1.06 |
| Sensible Capacity | | N/A | N/A | kW | N/A | N/A | kBtu/hr | |
| Total System Power Input | | 2.64 | 2.78 | kW | 2.64 | 2.78 | kW | 1.05 |
| Compressor Power Input | | 2.27 | 2.41 | kW | 2.27 | 2.41 | kW | 1.06 |
| Energy Efficiency Ratio (EER) | | 15.82 | 15.92 | Btu-hr/W | | | | 1.01 |
| Coeff. of Performance (COP) | | 4.64 | 4.66 | | | | | 1.01 |

| |
|------------------------------|
| Other System Changes |
| 3.5 TXV turns before closing |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|--------|--------------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 21.23 | 21.19 | °C | 70.21 | 70.14 | F | |
| Outlet Temperature | 37.79 | 41.08 | °C | 100.02 | 105.95 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 34.96 | 33.98 | m ³ /min | 1234.6 | 1199.98 5 | ft ³ /min | 0.97 |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 21.23 | 21.19 | °C | 70.21 | 70.14 | F | |
| Outlet Temperature | 37.79 | 41.08 | °C | 100.02 | 105.95 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|---|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | 15.36 | 953.88 | 15.40 | 859.48 | 59.65 | 138.35 | 59.73 | 124.66 |
| Compressor Discharge | 71.99 | 2450.46 | 65.05 | 2123.99 | 161.58 | 355.41 | 149.08 | 308.06 |
| Condenser Inlet | 65.07 | 2432.44 | 58.75 | 2099.26 | 149.13 | 352.79 | 137.76 | 304.47 |
| Condenser Outlet | 28.4 | 2399.23 | 32.95 | 2049.82 | 83.12 | 347.98 | 91.30 | 297.30 |
| Expansion Device Inlet | 27.6 | 2384.9 | 32.78 | 2030.14 | 81.68 | 345.90 | 91.00 | 294.44 |
| Subcooling, at expan. device | 11.7 | N/A | 7.42 | N/A | 21.06 | N/A | 13.36 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Suction Superheat | 9.64 | N/A | 2.08 | N/A | 17.35 | N/A | 3.74 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|------------------|
| Additional Notes |
| |
| |
| |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

Testing Participant: UMD-CEEE

Participant's Notation: High Temp. 2 Test

| Basic Information | |
|--|--------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr , Heat Pump |

| Comparison Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio | |
|--|-----------------|-----------|---------------------|-------|-------|----------------------|-------|--|
| Mode (Heating/Cooling) | Heating | | | | | | | |
| Compressor Type | Scroll | Scroll | | | | | | |
| Compressor Displacement | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 | |
| Nominal Motor Size | 3.8 | 3.8 | hp | | | | 1 | |
| Motor Speed | 3500 | 3500 | rpm | | | | 1 | |
| Expansion Device Type | R410A orifice | R410A TXV | | | | | | |
| Lubricant Charge | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 | |
| Refrigerant Charge | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 | |
| Refrigerant Mass Flow Rate | 2.96 | N/A | kg/min | 6.53 | N/A | lb/min | | |
| Composition, at compr. Inlet if applicable | | | % wt | | | | | |
| Ambient Temps. | Indoor, db | 21.24 | 21.27 | °C | 70.23 | 70.29 | F | |
| | Indoor, rh | 51.13 | 54.88 | % | 51.13 | 54.88 | % | |
| | Outdoor db | 8.3 | 8.14 | °C | 46.94 | 46.65 | F | |
| | Outdoor, dew pt | 4.45 | 4.11 | °C | 40.01 | 39.40 | F | |
| Total Capacity | 10.74 | 11.40 | kW | 36.65 | 38.89 | kBtu/hr | 1.06 | |
| Sensible Capacity | N/A | N/A | kW | N/A | N/A | kBtu/hr | | |
| Total System Power Input | 2.55 | 2.68 | kW | 2.55 | 2.68 | kW | 1.05 | |
| Compressor Power Input | 2.17 | 2.30 | kW | 2.17 | 2.30 | kW | 1.06 | |
| Energy Efficiency Ratio (EER) | 14.4 | 14.53 | Btu-hr/W | | | | 1.01 | |
| Coeff. of Performance (COP) | 4.22 | 4.26 | | | | | 1.01 | |

| |
|------------------------------|
| Other System Changes |
| 3.5 TXV turns before closing |
| |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|---------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 21.24 | 21.27 | °C | 70.23 | 70.29 | F | |
| Outlet Temperature | 35.54 | 37.58 | °C | 95.97 | 99.64 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 33.83 | 33.98 | m ³ /min | 1194.58 | 1199.92 | ft ³ /min | 0.97 |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 21.24 | 21.27 | °C | 70.23 | 70.29 | F | |
| Outlet Temperature | 35.54 | 37.58 | °C | 95.97 | 99.64 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|---|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | 6.62 | 835.75 | 6.86 | 660.85 | 43.92 | 121.21 | 44.35 | 95.85 |
| Compressor Discharge | 66.35 | 2304.52 | 66.12 | 1966.83 | 151.43 | 334.24 | 151.01 | 285.26 |
| Condenser Inlet | 58.701 | 2281.86 | 58.13 | 1945.59 | 137.66 | 330.95 | 136.64 | 282.18 |
| Condenser Outlet | 28.89 | 2254.86 | 27.40 | 1914.58 | 84.00 | 327.04 | 81.31 | 277.68 |
| Expansion Device Inlet | 27.81 | 2252.25 | 26.38 | 1916.87 | 82.06 | 326.66 | 79.49 | 278.02 |
| Subcooling, at expan. device | 9.16 | N/A | 11.39 | N/A | 16.48 | N/A | 20.50 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Suction Superheat | 5.16 | N/A | 2.08 | N/A | 9.29 | N/A | 3.74 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|------------------|
| Additional Notes |
| |
| |
| |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

Testing Participant: UMD-CEEE

Participant's Notation: Low Temp. Test

| Basic Information | |
|--|-------------------------|
| Alternative Refrigerant | D2Y60 |
| Alternative Lubricant Type and ISO Viscosity | POE |
| Baseline Refrigerant and Lubricant | R410A |
| Make and Model of System | SSZ140361BA/ARUF374316 |
| Nominal Capacity and Type of System | 36000 Btu/hr, Heat Pump |

| Comparison Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio | |
|--|-----------------|-----------|---------------------|-------|-------|----------------------|-------|--|
| Mode (Heating/Cooling) | Heating | | | | | | | |
| Compressor Type | Scroll | Scroll | | | | | | |
| Compressor Displacement | 0.096 | 0.126 | m ³ /min | 3.40 | 4.44 | ft ³ /min | 1.31 | |
| Nominal Motor Size | 3.8 | 3.8 | hp | | | | 1 | |
| Motor Speed | 3500 | 3500 | rpm | | | | 1 | |
| Expansion Device Type | R410A orifice | R410A TXV | | | | | | |
| Lubricant Charge | 0.71 | 0.71 | kg | 1.57 | 1.57 | lb | 1 | |
| Refrigerant Charge | 5.19 | 5.12 | kg | 11.44 | 11.29 | lb | 0.99 | |
| Refrigerant Mass Flow Rate | N/A | N/A | kg/min | N/A | N/A | lb/min | | |
| Composition, at compr. Inlet if applicable | | | % wt | | | | | |
| Ambient Temps. | Indoor, db | 21.27 | 21.30 | °C | 70.29 | 70.34 | F | |
| | Indoor, rh | 49.61 | 48.42 | % | 49.61 | 48.42 | % | |
| | Outdoor, db | -8.79 | -8.53 | °C | 16.18 | 16.65 | F | |
| | Outdoor, dew pt | -11.07 | -11.82 | °C | 12.07 | 10.73 | F | |
| Total Capacity | 6 | 6.50 | kW | 20.47 | 22.18 | kBtu/hr | 1.08 | |
| Sensible Capacity | N/A | N/A | kW | N/A | N/A | kBtu/hr | | |
| Total System Power Input | 2.34 | 2.47 | kW | 2.34 | 2.47 | kW | 1.05 | |
| Compressor Power Input | 1.97 | 2.10 | kW | 1.97 | 2.10 | kW | 1.06 | |
| Energy Efficiency Ratio (EER) | 8.76 | 8.99 | Btu-hr/W | | | | 1.03 | |
| Coeff. of Performance (COP) | 2.57 | 2.63 | | | | | 1.02 | |

| |
|------------------------------|
| Other System Changes |
| 3.5 TXV turns before closing |
| |
| |

Type of System: Air-Source Split HP

Alternate Refrigerant: D2Y60

| Air/Water Side Data | Base. | Alt. | SI Units | Base. | Alt. | IP Units | Ratio |
|---------------------|-------|-------|---------------------|---------|----------|----------------------|-------|
| Evaporator | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | N/A | N/A | m ³ /min | N/A | N/A | ft ³ /min | |
| Flow Rate (liquid) | N/A | N/A | L/min | N/A | N/A | gal/min | |
| Inlet Temperature | 21.27 | 21.30 | °C | 70.29 | 70.34 | F | |
| Outlet Temperature | 29.55 | 30.35 | °C | 85.19 | 86.64 | F | |
| Condenser | | | | | | | |
| Heat Exchange Fluid | Air | Air | | | | | |
| Flow Rate (gas) | 34.15 | 33.98 | m ³ /min | 1205.85 | 1199.981 | ft ³ /min | 1 |
| Flow Rate (liquid) | N/A | N/A | kg/min | N/A | N/A | lb/min | |
| Inlet Temperature | 21.27 | 21.30 | °C | 70.29 | 70.34 | F | |
| Outlet Temperature | 29.55 | 30.35 | °C | 85.19 | 86.64 | F | |

| Refrigerant Side Data Temperatures & Pressures | Baseline | | Alternative | | Baseline | | Alternative | |
|---|----------|---------|-------------|---------|----------|----------|-------------|----------|
| | T (°C) | P (kPa) | T (°C) | P (kPa) | T (F) | P (psia) | T (F) | P (psia) |
| Compressor Suction | -13.29 | 521.69 | -10.10 | 353.71 | 8.08 | 75.66 | 13.81 | 51.30 |
| Compressor Discharge | 52.45 | 1943.28 | 76.42 | 1650.99 | 126.41 | 281.85 | 169.55 | 239.45 |
| Condenser Inlet | 41.569 | 1912.82 | 54.85 | 1633.83 | 106.82 | 277.43 | 130.73 | 236.97 |
| Condenser Outlet | 30.08 | 1894.01 | 22.62 | 1621.67 | 86.14 | 274.7 | 72.71 | 235.20 |
| Expansion Device Inlet | 28.96 | 1910.26 | 21.09 | 1647.65 | 84.13 | 277.06 | 69.96 | 238.97 |
| Subcooling, at expan. device | 1.46 | N/A | 10.46 | N/A | 2.63 | N/A | 18.82 | N/A |
| Evaporator Inlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Evaporator Outlet | N/A | N/A | N/A | N/A | N/A | N/A | N/A | N/A |
| Suction Superheat | -0.62 | N/A | 3.41 | N/A | -1.16 | N/A | 6.13 | N/A |

| |
|---|
| Data Source(s) for Refrigerant Properties |
| Refrigerant supplier |
| |

| |
|---------------------------|
| Additional Notes |
| Air Side Capacity and COP |

Submitted by: Abdullah Alabdulkarem and Dr. Yunho Hwang

- **Cyclic heating tests**

The cyclic condition included two cycles. Each cycle was comprised of 6 minutes “on” time and 24 minutes “off” time (Figure 11). Specific calculation procedure followed ARI standard 210/240 (1995). The summary of the results of the cyclic heating test are shown in Table 9.

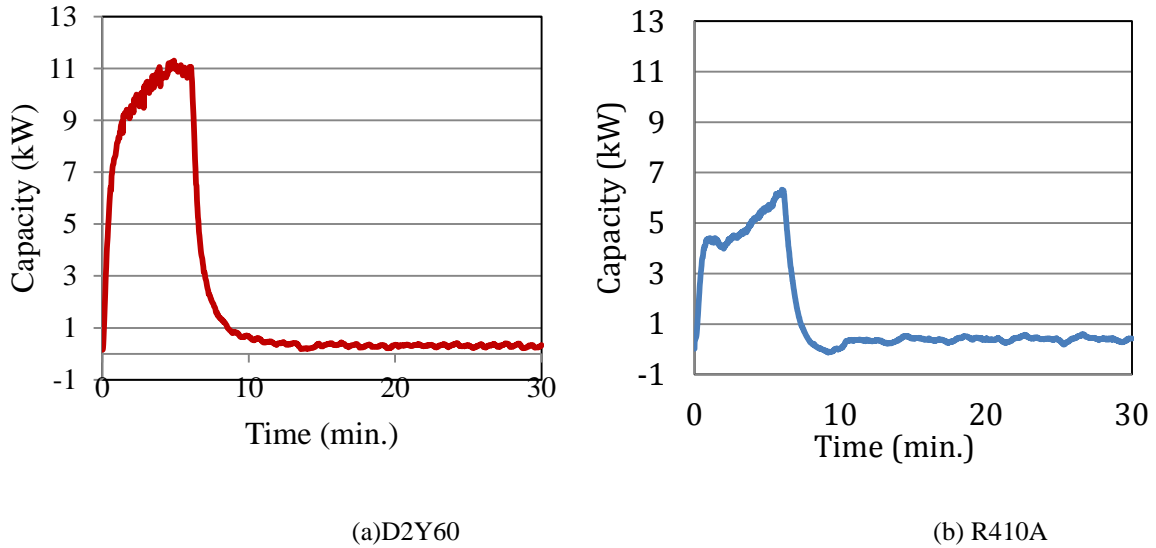


Figure 11: Heating capacity vs. time for cyclic heating test.

Table 9: Cyclic heating results and HSPF.

| | Heating-Air Side (kW-hr) | Power Consumption (kW-hr) | COP | Heating Load Factor (HLF) | Degradation Coefficient (CD) | HSPF |
|----------------|--------------------------|---------------------------|-----|---------------------------|------------------------------|------|
| R410A | 0.53 | 0.24 | 2.2 | 0.11 | 0.49 | 7.57 |
| D2Y60 | 1.08 | 0.28 | 3.9 | 0.19 | 0.10 | 8.88 |
| Difference (%) | 104 | 17 | 77 | 73 | -80 | 17 |

- **Frost accumulation tests**

The cyclic condition included two cycles. Each cycle was comprised of the start of the defrosting cycle until the start of the next defrosting cycle (Figure 12). Specific calculation procedure followed ARI standard 210/240 (1995). The summary of the results are shown in Table 10.

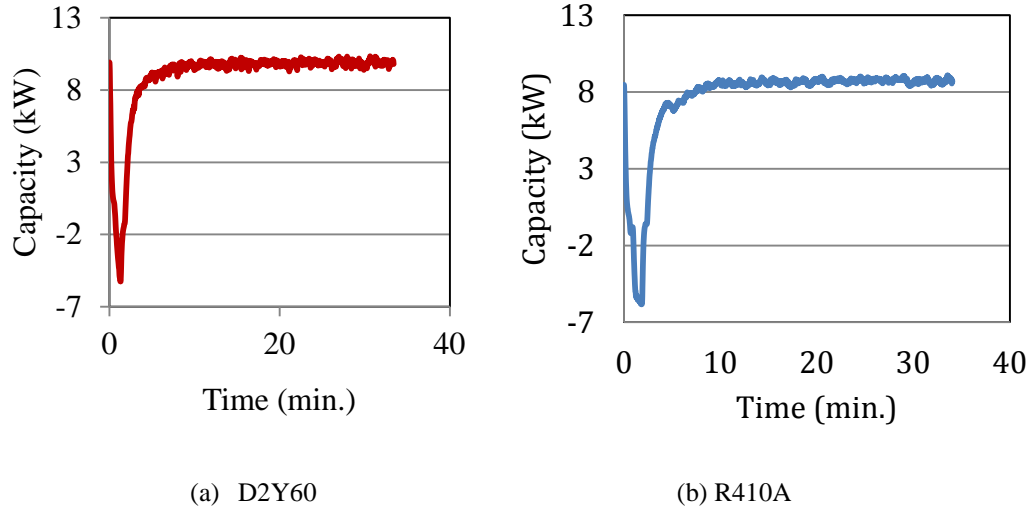


Figure 12: Heating capacity vs. time for frost accumulation test.

Table 10: Heating capacity and COP for frost accumulation tests.

| | Heating-Air side (kW-hr) | Average Heating Capacity (kW) | COP |
|----------------|--------------------------|-------------------------------|------|
| R410A | 4.31 | 7.59 | 3.23 |
| D2Y60 | 4.97 | 8.94 | 3.53 |
| Difference (%) | 15 | 18 | 9 |